

S-VENT[®] SUBMITTAL SHEET




Anemostat[®]
A MESTEK COMPANY

P.O. BOX 4938 • 1220 WATSONCENTER ROAD • CARSON, CA 90745-4206
(310) 835-7500 • FAX (310) 835-0448
e-mail: airsec@anemostat.com • website: www.anemostat.com


SSV22-__-PC

SPECIFY TYPE
MAXIMUM SECURITY GRILLE
3/16" X 3/16" OPENING
with
ANCHOR STUDS FOR
PRECAST CONCRETE


TOP SECTION

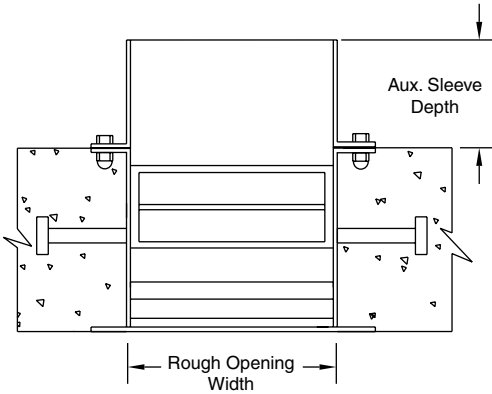

FRONT SECTION

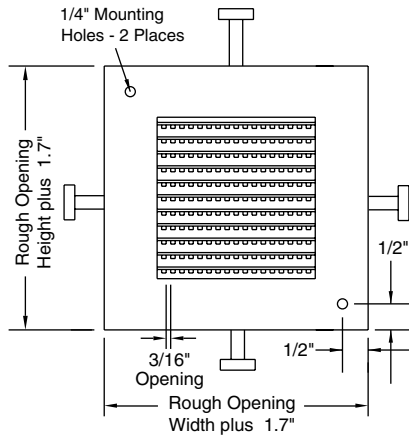

SIDE SECTION

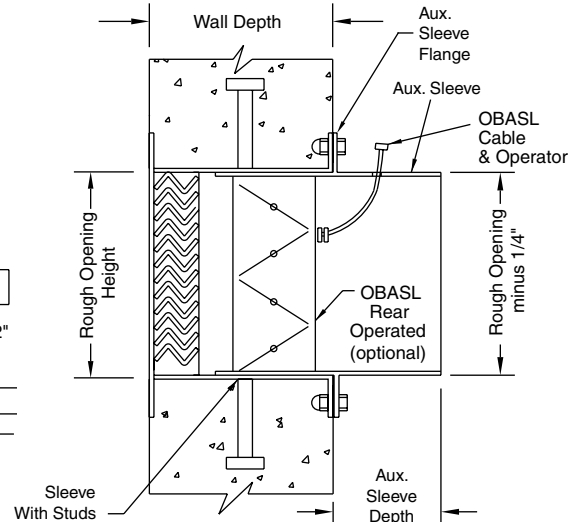

IMPORTANT: It is the specifier's responsibility to properly configure the HVAC system to meet the appropriate level of comfort, safety, security and detention

PRODUCT FEATURES

Face Flange

14 GA (standard)

Material Type

Stainless Steel (standard)

Horizontal Louvers/Vertical Mullions

14 GA with 1 7/16" Neck Depth (std)

Finish

2B Mill Finish (std)

Beige Powder Coat-5 to 7 mil (opt)

White Powder Coat-5 to 7 mil (opt)

Other Powder Coat Colors _____

Sleeve (standard)

14 GA Galvanized - specify length _____

Auxiliary Sleeve with Flange (optional)

14 GA Galvanized - specify length _____

Opposed Blade Damper (optional)
(galvanized, shipped loose)

Rear Operated with ASL Cable

Anchoring Studs (standard)

Nelson Type - specify stud size _____

MUST **SPECIFY TYPE** (BASED ON ROUGH OPENING SIZE)
AS PART OF MODEL NUMBER WHEN PLACING ORDER

ROUGH OPENING SIZES (WIDTH X HEIGHT)

| Dimensions in Inches | | WIDTH | | | | | | | | |
|----------------------|------|-------|-----|------|------|------|------|------|------|------|
| | | 6.3 | 8.3 | 10.3 | 12.3 | 14.3 | 16.3 | 18.3 | 20.3 | 22.3 |
| HEIGHT | 6.3 | A1 | B1 | C1 | D1 | E1 | F1 | G1 | H1 | J1 |
| | 8.3 | A2 | B2 | C2 | D2 | E2 | F2 | G2 | H2 | J2 |
| | 10.3 | A3 | B3 | C3 | D3 | E3 | F3 | G3 | H3 | J3 |
| | 12.3 | A4 | B4 | C4 | D4 | E4 | F4 | G4 | H4 | J4 |
| | 14.3 | A5 | B5 | C5 | D5 | E5 | F5 | G5 | H5 | J5 |
| | 16.3 | A6 | B6 | C6 | D6 | E6 | F6 | G6 | H6 | J6 |
| | 18.3 | A7 | B7 | C7 | D7 | E7 | F7 | G7 | H7 | J7 |
| | 20.3 | A8 | B8 | C8 | D8 | E8 | F8 | G8 | H8 | J8 |
| | 22.3 | A9 | B9 | C9 | D9 | E9 | F9 | G9 | H9 | J9 |

| QTY | TYPE | ROUGH OPENING W" X H" | | WALL DEPTH |
|-----|------|-----------------------|------|------------|
| 27 | C3 | 10.3 | 10.3 | 6" |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

SUBMITTAL APPROVAL

| | | | |
|------------------------------|------|---------------------|------|
| Job Name and Location | | | |
| Engineer | Date | Factory | Date |
| Mfr. Rep. | Date | Submitted By | Date |